


ADD 63.5 [2.50] IN HEIGHT TO ALLOW FOR REMOVAL OF LID 157.8 [6.21] 12.6 [0.50] 9.5 [0.38] -- 74.9 [2.95] **-**



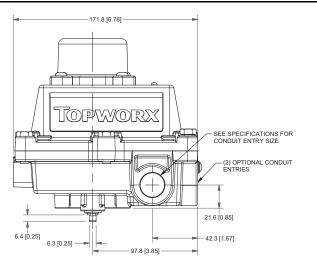



NAMEPLATE







CI I Div 2, Grps A-D; CI II Div 2, Grps F-G Type 4X; T4 -50°C \leq Ta \leq 60°C Ex nC IIC T6/T4 Gc; -60°C \leq Ta \leq 40°C/60°C SWITCH: SPDT 4A/120VAC; 3A/24VDC Hermetically Sealed; Telemetering Equipment for use in Hazardous Locations WARNINGS. Substitution of components may impair subsibily for use in Class I. Division 2 or Zone 2 environments. Must be for use in Class I. Division 2 or Zone 2 environments. Must be that the Class I division of the Class o

Telemetering Equipment for use in Hazardous Locations





OPEN



MODEL NUMBER

DXP-L22GS4B

PRODUCT LINE

Switchbox DXP and DXS

SPECIFICATIONS

Enclosure Tropicalized aluminum

(2) GOTM Switches SPDT hermetic seal Bus/Sensor

Non-incendive Area Classification

Visual Display Standard 90° Green OPEN, Red CLOSED


Shaft ½" DD 316 stainless steel Conduit Entries $(2)^{\frac{3}{4}}$ " NPT, $(2)^{\frac{1}{2}}$ " NPT

Buna-N

O-Rings Pilot No pilot device(s) Spool Valve No spool valve No valve Cv Valve Cv Manual Override No manual override Regional Certification No regional certification

N Switch No N Switch

WIRING DIAGRAM



Current as of September 12, 2023 - Subject to change without notice.

TOPWORX

3300 Fern Valley Road Louisville, KY 40213

(502)969-8000 PH (502)969-5911 FAX www.topworx.com

Model #:

Serial #: